



THE PORT AUTHORITY
OF NY & NJ

CONFORMED DRAWING
10/9/98
SIGNED AND SEALED
COPY IS KEPT ON FILE

ORIGINAL SIGNED & SEALED BY
NY P.E. (OR R.A.)

Joseph R. Loring
& Associates, Inc.
consulting engineers
One Pennsylvania Plaza
New York, New York 10001-2041
Tel: (212) 363-7400, Fax: (212) 363-7382


THE OFFICE OF
DAVID
ELLIOT
LEBOVITZ
P.C.
ARCHITECTS & PLANNERS
100 WEST 40TH STREET, NEW YORK, NY 10018
TEL: (212) 363-7400 FAX: (212) 363-7382

LESLIE E ROBERTSON
ASSOCIATES, R.L.L.P.
CONSULTING ELECTRICAL ENGINEERS
200 EAST 40TH STREET
NEW YORK, NY 10018
TEL: (212) 363-7400 FAX: (212) 363-7382


- NOTES:
1. LIGHTING FIXTURES AT THE ENTRANCE DOOR SHALL BE CONTROLLED WITH BUILDING LIGHTING CONTROL TIME SWITCH THRU A SINGLE POLE LOCATED AT PANEL 1P.
 2. FOR SYMBOL LIST SEE DWG. 11-04.
 3. ALL LIGHT FIXTURES INDICATED TO BE PROVIDED WITH AN EMERGENCY BATTERY BACKUP PACK SHALL BE WIRED TO PROVIDE CONNECTION TO THE LINE SIDE OF THE LOCAL SWITCH CONTROL.

LIGHTING FIXTURE SCHEDULE

TYPE	FA
DESCRIPTION	1x4 2-LAMP GENERAL PURPOSE PENDENT MOUNTED INDUSTRIAL TYPE FLUORESCENT FIXTURE WITH REFLECTOR
MANUFACTURER/CATALOG NO.	LITHONIA #612 48 277 ES NYC OR APPROVED EQUAL
LAMPS/VOLTAGE	(2) 32W T8 277 VOLT ELECTRONIC BALLAST
TYPE	FA-1
DESCRIPTION	1x4 1-LAMP GENERAL PURPOSE PENDENT MOUNTED INDUSTRIAL TYPE FLUORESCENT FIXTURE WITH REFLECTOR
MANUFACTURER/CATALOG NO.	LITHONIA #611 48 277 ES NYC OR APPROVED EQUAL
LAMPS/VOLTAGE	(1) 32W T8 277 VOLT ELECTRONIC BALLAST
TYPE	FA-2
DESCRIPTION	1x4 2-LAMP GENERAL PURPOSE PENDENT MOUNTED INDUSTRIAL TYPE FLUORESCENT FIXTURE WITH REFLECTOR AND EMERGENCY BALLAST / BATTERY PACK
MANUFACTURER/CATALOG NO.	LITHONIA #612 48 277 ES NYC OR APPROVED EQUAL
LAMPS/VOLTAGE	(2) 32W T8 277 VOLT ELECTRONIC BALLAST
TYPE	FB
DESCRIPTION	IMPACT RESISTANT, FLUORESCENT, ALL WEATHER CASKETEED FIXTURE COLOR BLACK TO MATCH PANEL
MANUFACTURER/CATALOG NO.	HUBBEL #NRC100/500 SERIES NRC-125-4W
LAMPS/VOLTAGE	(1) 20W 120 VOLT FACTORY INSTALLED BALLASTS
TYPE	FC
DESCRIPTION	2-LAMP, EXPLOSION PROOF, MOUNTED FLUORESCENT FIXTURE WITH HEAVY-DUTY GLASS LAMP TUBES IMPACT RESISTANCE
MANUFACTURER/CATALOG NO.	CROUSE-HINDS #EVT 22022
LAMPS/VOLTAGE	(2) 32W T8 120 VOLT ELECTRONIC BALLAST
TYPE	FC-1
DESCRIPTION	2-LAMP, EXPLOSION PROOF, MOUNTED FLUORESCENT FIXTURE WITH EMERGENCY BALLAST/BATTERY PACK
MANUFACTURER/CATALOG NO.	CROUSE-HINDS #EVT 22022
LAMPS/VOLTAGE	(2) 32W T8 120 VOLT EMERGENCY BALLAST
TYPE	X
DESCRIPTION	EDGE/IT LED EXIT LIGHT WITH 8" HIGH RED LETTERS ON CLEAR BACKGROUND PROVIDE INTERNAL EMERGENCY BATTERY PACK
MANUFACTURER/CATALOG NO.	PEACHTREE # PFT-8326-04A OR APPROVED EQUAL
LAMPS/VOLTAGE	LED 277 VOLT
TYPE	XA
DESCRIPTION	EDGE/IT LED EXIT LIGHT WITH 8" HIGH RED LETTERS ON CLEAR BACKGROUND FACTORY SEALED EXPLOSION-PROOF HOUSING
MANUFACTURER/CATALOG NO.	CROUSE-HINDS #EXL 21A
LAMPS/VOLTAGE	(2) 62W 120 VOLT

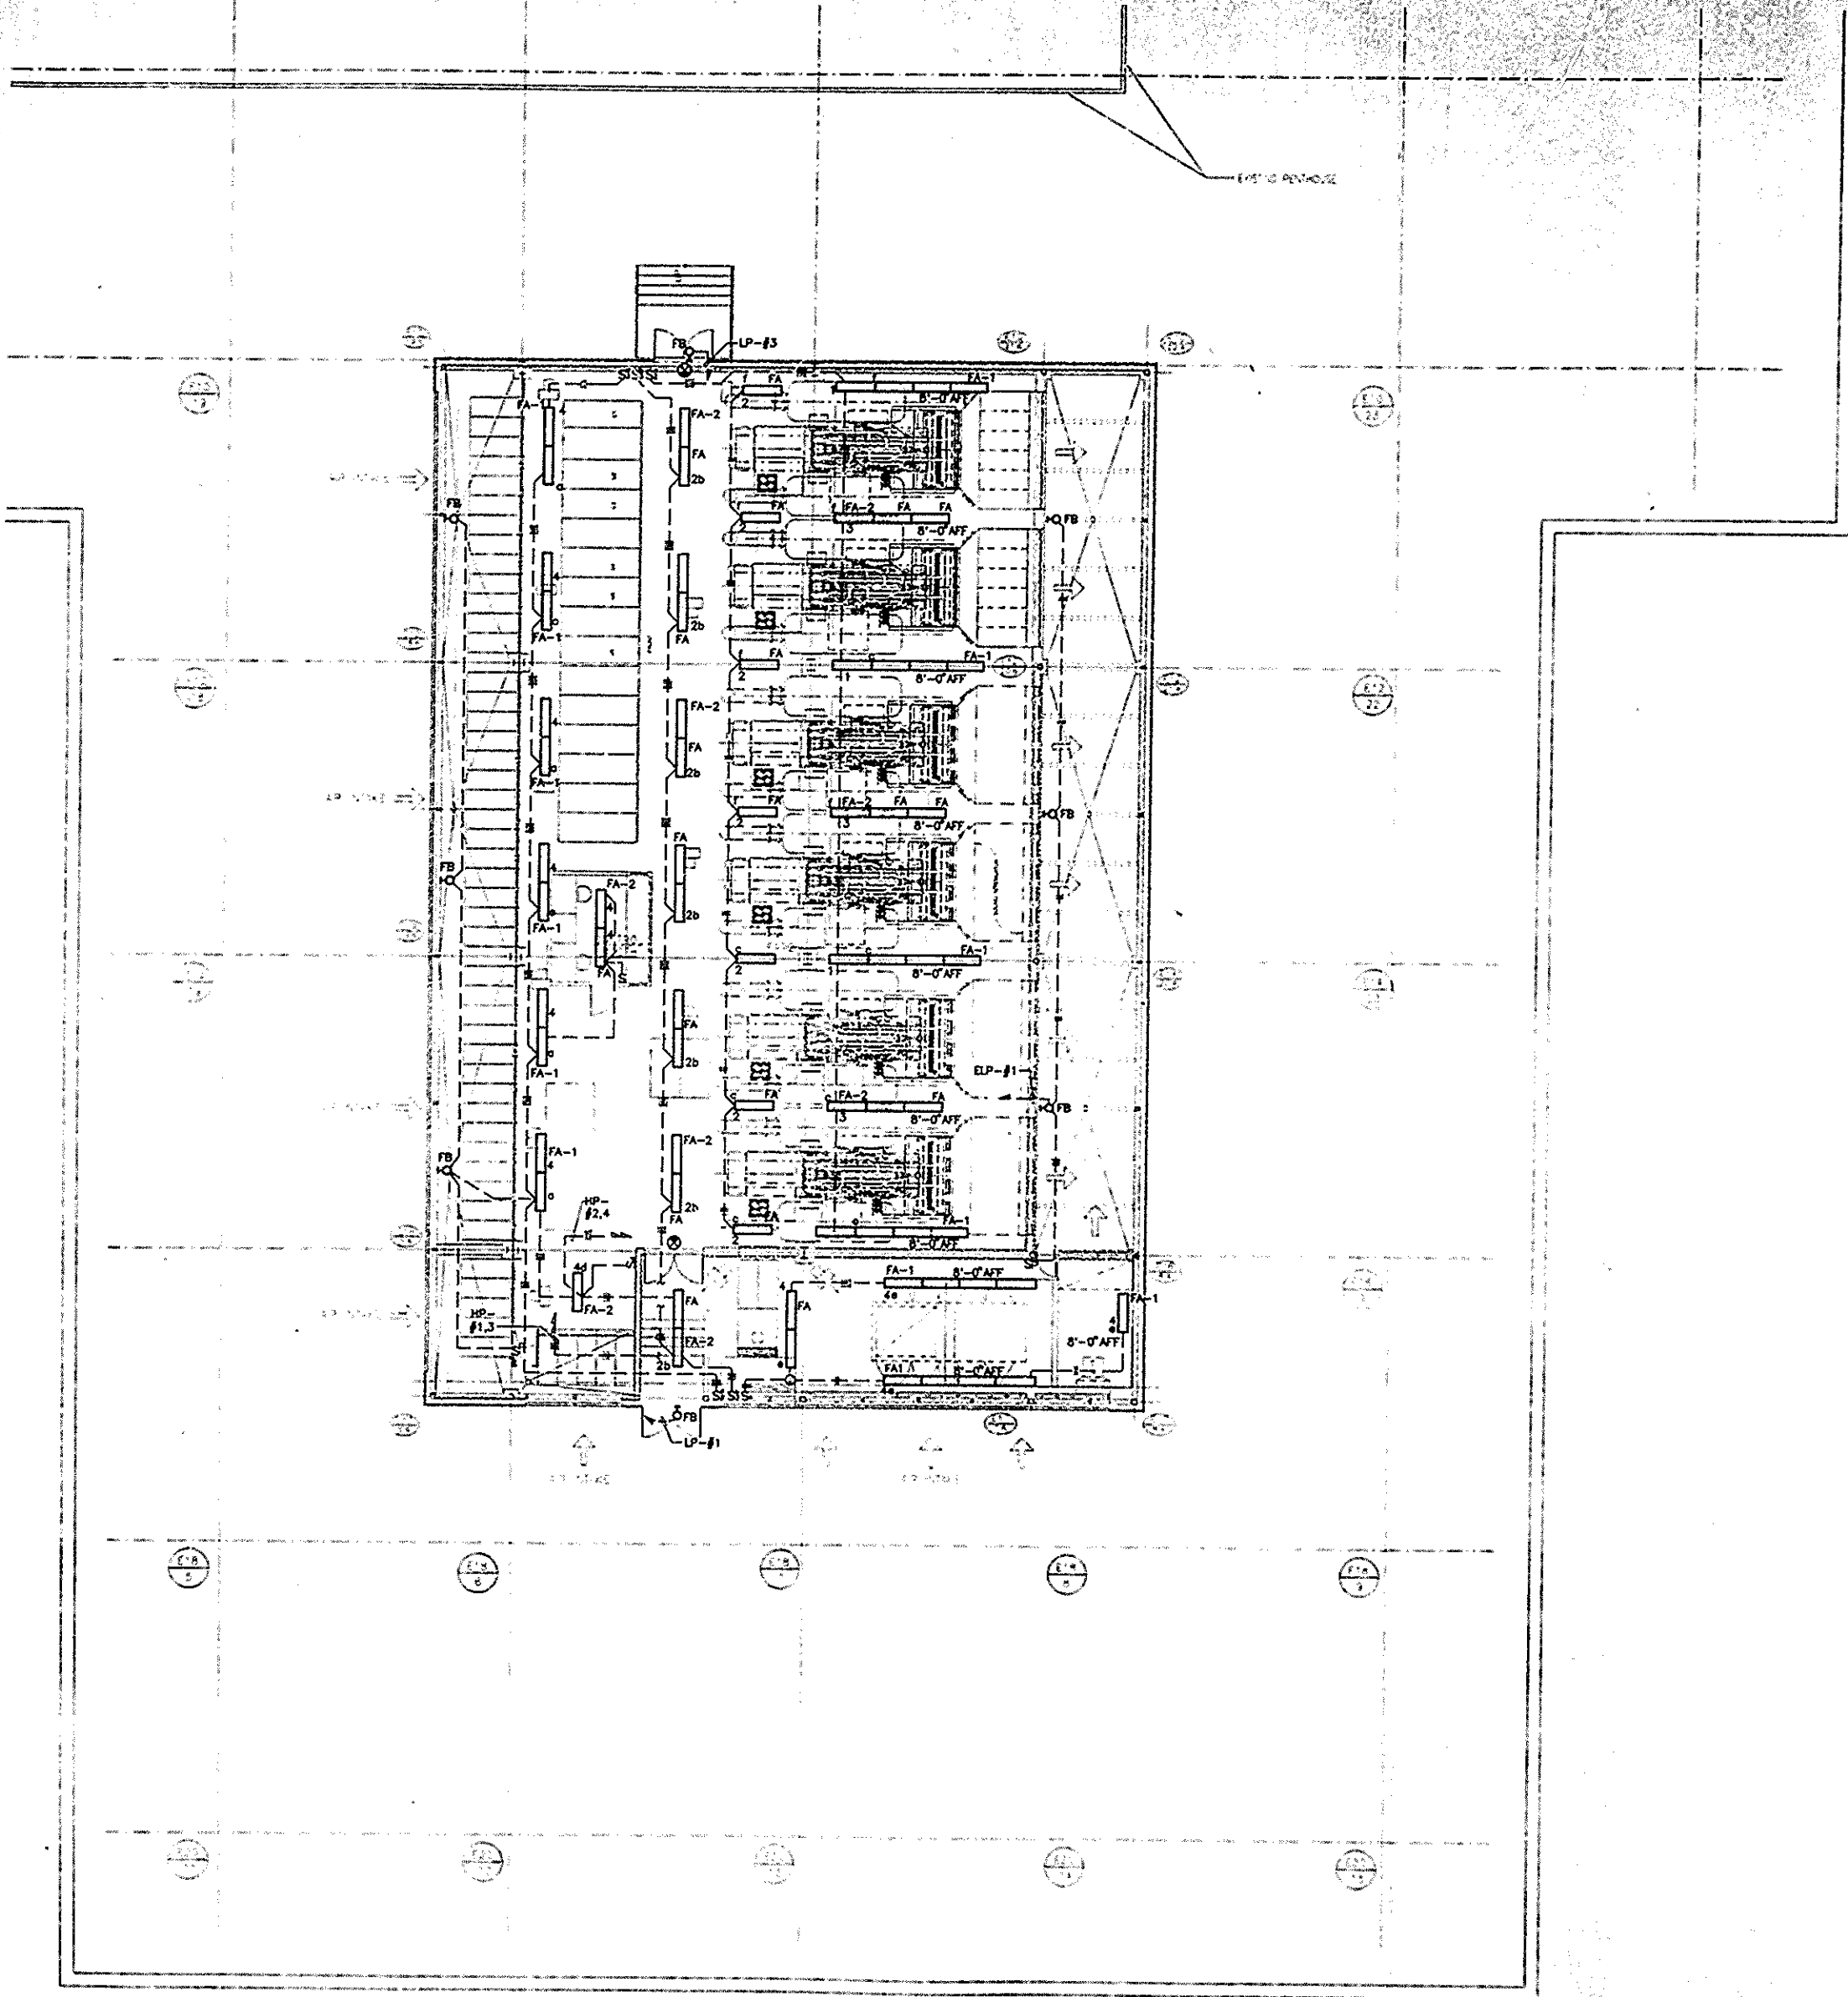

5 WTC STANDBY GENERATOR BULKHEAD
LIGHTING PLAN

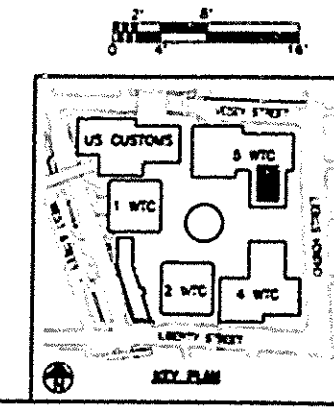

No. Date Revision Approved
Engineering Department
Design Division

The
World
Trade
Center

STANDBY POWER
5 WORLD TRADE CENTER
ELECTRICAL
GENERATOR BULKHEAD
LIGHTING PLAN

This drawing is subject to conditions in contract
as in versions, issues, designs and methods
herein are reserved to Port Authority and
may not be used without its written consent.

Prepared by	Checked by	Drawn by	Scale
11/17/97	AS NOTED		
Contract Number	Drawing Number		
WTC-945071	E2-03		